# DCPS Lead Testing Results

Exceeding 20 ppb

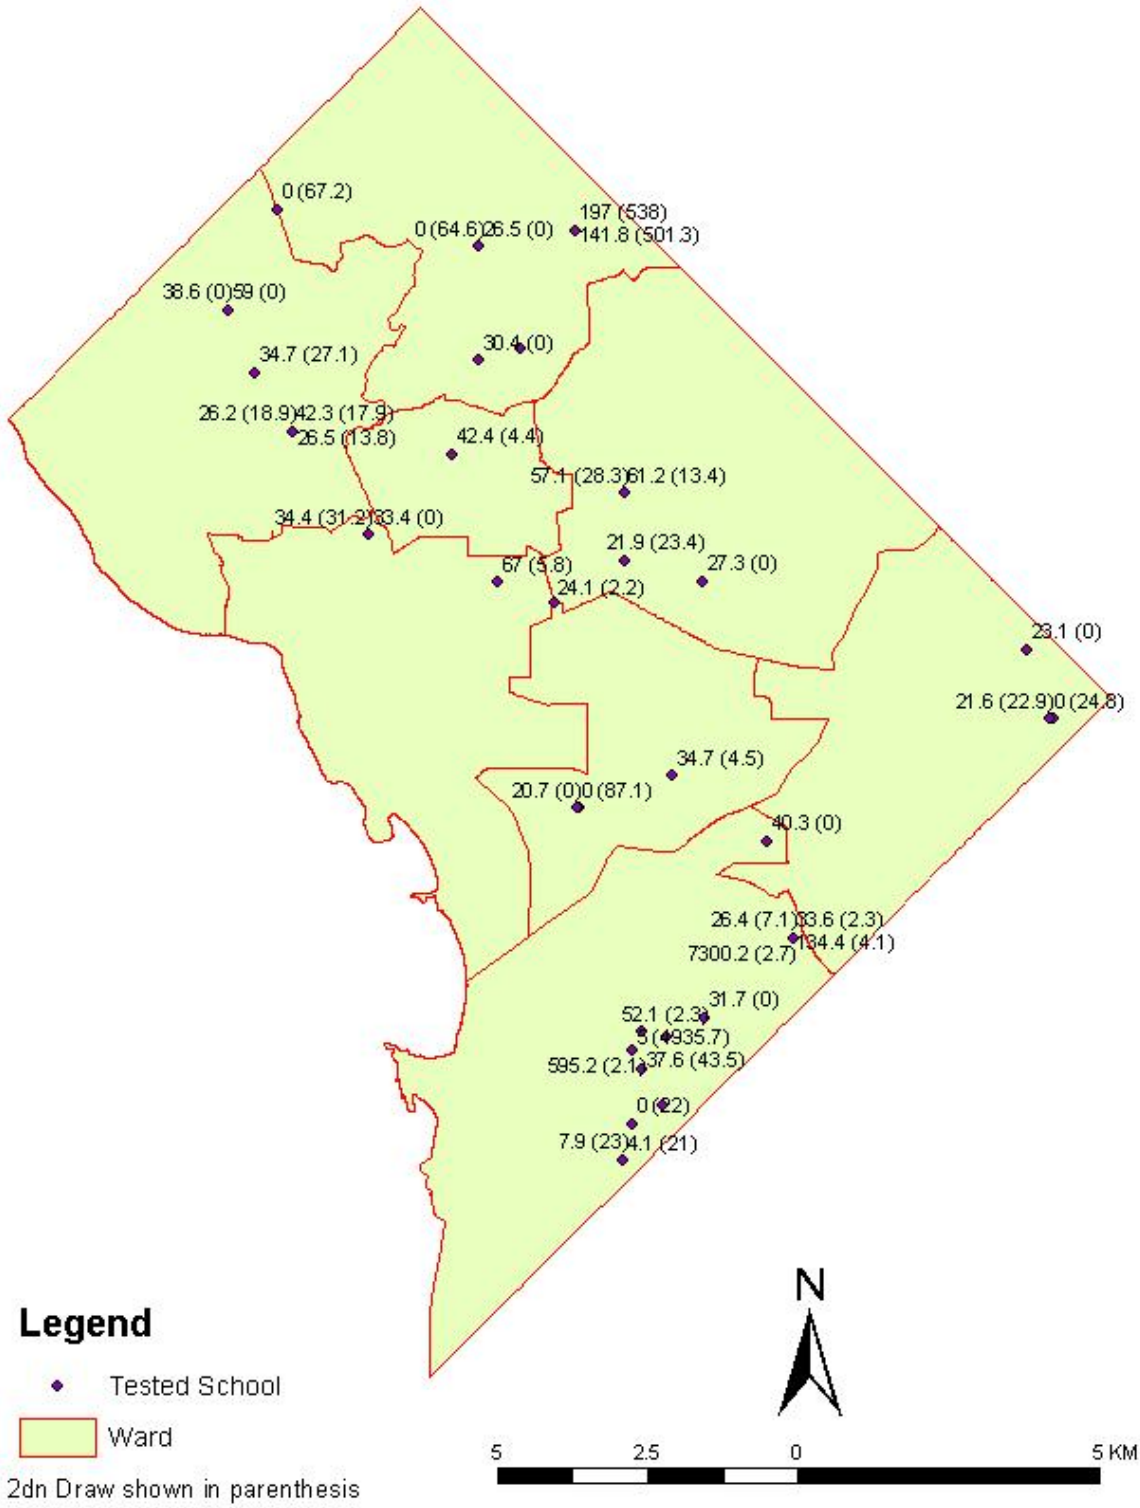


DOH/EHA/BEQ/Water Quality Division

April 28, 2004